


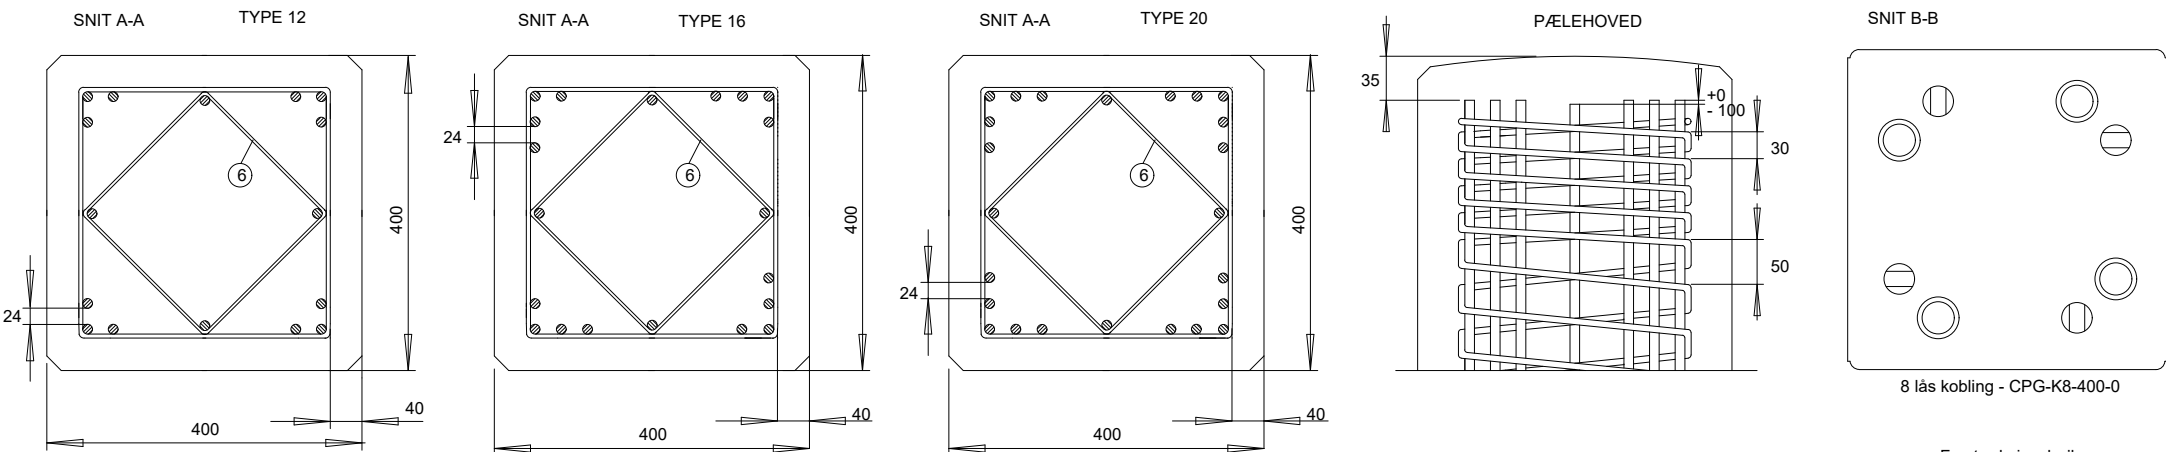

This document and its contents are the exclusive property of Centrum Pøle A/S. The drawing must not be copied, reproduced, transmitted or communicated to any other party or used for purposes not expressly permitted by Centrum Pøle A/S. Only to the extent expressly agreed by Centrum Pøle A/S this document may constitute a contractual obligation on our part.

 CENTRUM	CENTRUM PÆLE A/S GRØNLANDSVEJ 96, 7100 VEJLE TLF. (+45) 75 83 01 11	Tegnet af	DBP
		Dato	11.02.2026
		Erstatter	03.11.2025
CENTRUM KOBLINGSPÆL K8 400/400		Tegning nr.	40-K8
Projekt			

Eksponeringsklasser og trykstyrke for pæle program

Danmark: Styrkeklassen for pæle er C45/55 ift. EN 206 og DS 206

Deutschland: Die Festigkeitsklasse für Pfähle beträgt C50/60 im Vergleich zu EN 206

Beton- recept Dæklag	Danmark		Deutschland	
	DS/EN 206 + DS 206 DS/EN 1992-1-1 + DK NA		DIN 1045-2 DIN/EN 1992-1-1 + NA	
	40	50	40	50
S2 ¹	XC4, XS2, XD1, XA2 ⁵	XC4, XS2, XD1, XA2 ⁵	XC4, XA2 ⁵	XC4, XS3, XD3, XA2 ⁵
S3 ²	XC4, XS2, XD1, XA2	XC4, XS2, XD1, XA2	XC4, XA2 ⁵	XC4, XS3, XD3, XA2 ⁵
G3 ³	XC4, XS3, XD3, XA2	XC4, XS3, XD3, XA2	N/A	N/A
B3 ⁴	XC4, XS2, XD1, XA2	XC4, XS2, XD1, XA2	XC4, XA2	XC4, XS3, XD3, XA2

N/A = Ikke relevant/Nicht zutreffend

Note 1: CEM II/A-LL N 52,5 MA eller CEMII/B-M (S,LL) 52,5 N LA/MS

Note 2: CEM I 52,5 N MA/MS eller CEMII/B-M (S,LL) 52,5 N LA/MS

Note 3: CEM I 52,5 N MA/MS

Note 4: CEM I 42,5 R SR-0 LA

Note 5: Grænseværdier for sulfatindhold/Grenzwerte für die sulfatinhalt:

Grænseværdier for kemisk eksponering findes i tabel 2 i EN 206.

Ved kontakt med havvand må grænseværdien for sulfatindhold ikke overskride XA1

- Grundvand/Grundwasser: ≤ 600 mg/l
- Jord/Boden: ≤ 3000 mg/kg

This drawing must not be passed on to or made use of by any person not authorized by Centrum Pæle A/S	 CENTRUM	Projektion: 				
		Drawing size: A4	Date	03-07-2026		
		Scale:	Designer			
		Unit: mm	Drawer	David		
Beton eksponeringsklasser				Weight		
				Material		
				Sparepart		
				Revision		
				Sheet 1 / 1	1.9	